
### INSTRUCTION MANUAL D2xB1X05 & D2xB1X10 Xenon Beacons







D2XB1X05 D2XB1X10

#### 1) Product Table

Model	Nom. Voltage	Voltage Range	Operating rms Current
D2xB1X05DC024	24Vdc	20-28Vdc	296mA
D2xB1X05DC048	48Vdc	48Vdc	145mA
D2xB1X05AC115	115Vac	115-120Vac 50/60Hz	80mA
D2xB1X05AC230	230Vac	220-230Vac 50/60Hz	30mA
D2xB1X10DC024	24Vdc	20-28Vdc	609mA
D2xB1X10DC048	48Vdc	48Vdc	260mA
D2xB1X10AC115	115Vac	115-120Vac 50/60Hz	185mA
D2xB1X10AC230	230Vac	220-230Vac 50/60Hz	107mA
Table 1: Electrical Ratings.			•

#### 2) Warnings



- DO NOT OPEN WHEN AN EXPLOSIVE ATMOSPHERE IS PRESENT
- DO NOT OPEN WHEN ENERGISED
- POTENTIAL ELECTROSTATIC CHARGING HAZARD - CLEAN ONLY WITH A DAMP CLOTH
- HIGH VOLTAGE SHOCK HAZARD. WAIT 5 MINUTES AFTER REMOVING POWER BEFORE OPENING THE ENCLOSURE

#### **Avertissement:**

- NE PAS OUVRIR UN PRESENCE D'ATMOSPHERE EXPLOSIVE
- NE PAS OUVRIR ENERGIE
- DANGER POTENTIEL CHARGE ÉLECTROSTATIQUE - NETTOYER UNIQUEMENT AVEC UN CHIFFON HUMIDE
- HAUT TENSION, RISK DE CHOC. ATTENDEZ 5 MÍNUTES APRES AVOIR DEBRANCHE L'ALIMENTATION AVANT D'OUVRIR LA BOITIER

#### 3) Rating & Marking Information

All units have a rating label, which carries the following important information:

- Unit Model.
- Voltage Range
- Nominal Voltage

See Table 1 for electrical ratings of each Unit Model.

#### 3.1. Fire Alarm Ratings

The Following models are certified as visual alarm devices for private mode visual alarm devices in accordance with UL1638 Fifth Edition / CAN/ULC-S526 Fourth Edition when used with clear or red lens covers:

D2XB1X05DC024; D2XB1X05DC048 D2XB1X10DC024; D2XB1X10DC048

See fire instruction manual D211-00-201-IS-SC-UL

www.e2s.com

#### 3.2. ATEX / IECEx / UKEx Ratings

#### Standards

EN IEC 60079-0:2018 / IEC60079-0:2017 (Ed 7):

Explosive Atmospheres - Equipment. General Requirements

EN IEC 60079-7:2015 +A1:2018 / IEC 60079-7:2018 (Ed. 5.1): Explosive Atmospheres - Equipment Protection by Increased

Safety "e" EN 60079-31:2014 / IEC 60079-31:2013 (Ed 2):

Explosive Atmospheres - Equipment Dust Ígnition Protection by Enclosure "t"

Ratings		
D2xB1: X05DC024	Ex ec IIC T2 Gc Ta -40°C to +50°C Ex tc IIIC T80°C Dc Ta -40°C to +50°C	
D2xB1: X05DC048 X05AC115 X05AC230	Ex ec IIC T3 Gc Ta -40°C to +50°C Ex tc IIIC T95°C Dc Ta -40°C to +50°C	
D2xB1: X10DC024	Ex ec IIC T1 Gc Ta -40°C to +50°C Ex tc IIIC T105°C Dc Ta -40°C to +50°C	
D2xB1: X10DC048 X10AC115 X10AC230	Ex ec IIC T2 Gc Ta -40°C to +50°C Ex tc IIIC T95°C Dc Ta -40°C to +50°C	

Certificate No.

DEMKO 14 ATEX 4786493904X IECEX ULD 14.0004X

UL21UKEX2131X

ATEX Mark, Equipment Group and Category:



II 3G II 3D

**CE Marking** 



**UKCA Marking** 

#### 3.3. NEC & CEC Ratings

#### NEC & CEC Class / Division Ratings for US / Canada

Standards		
UL 121201-2021 (Ed. 9) CAN/CSA C22.2 No. 213-17 (Ed. 3)		
	Ratings	
D2xB1: X05DC024	Class I Div 2 ABCD T2D Ta -40°C to +50°C Class I Div 2 ABCD T3 Ta -40°C to +45°C Class II Div 2 FG T6 Ta -40°C to +50°C Class III Div 1&2 Ta -40°C to +50°C	
D2xB1: X05DC048 X05AC115 X05AC230	Class I Div 2 ABCD T3 Ta -40°C to +50°C Class II Div 2 FG T5 Ta -40°C to +50°C Class II Div 2 FG T6 Ta -40°C to +40°C Class III Div 1&2 Ta -40°C to +50°C	
D2xB1: X10DC024	Class I Div 2 ABCD T1 Ta -40°C to +50°C Class I Div 2 ABCD T2 Ta -40°C to +45°C Class II Div 2 FG T4A Ta -40°C to +50°C Class II Div 2 FG T5 Ta -40°C to +45°C Class III Div 1&2 Ta -40°C to +50°C	

D2xB1:	Class I Div 2 ABCD T2B Ta -40°C to +50°C
X10DC048	Class II Div 2 FG T5 Ta -40°C to +50°C
X10AC115	Class II Div 2 FG T6 Ta -40°C to +40°C
X10AC230	Class III Div 1&2 Ta -40°C to +50°C

Installation must be carried out in compliance with the National Electric Code / Canadian Electric Code

#### **NEC Class / Zone ratings US**

Standards		
UL 60079-0 (Ed. 7):     Explosive Atmospheres - part 0: Equipment - General Requirements UL 60079-7 (Ed. 5):     Explosive Atmospheres - Equipment Protection by Increased Safety "e" UL 60079-31 (Ed. 2)     Explosive Atmospheres - Equipment Dust Ignition Protection by Enclosure "t"		
	Ratings	
D2xB1: X05DC024	Class I Zone 2 AEx ec IIC T2 Gc Ta -40°C to +50°C Zone 22 AEx tc IIIB T80°C Dc Ta -40°C to +50°C	
D2xB1: X05DC048 X05AC115 X05AC230	Class I Zone 2 AEx ec IIC T3 Gc Ta -40°C to +50°C Zone 22 AEx tc IIIB T95°C Dc Ta -40°C to +50°C	
D2xB1: X10DC024	Class I Zone 2 AEx ec IIC T1 Gc Ta -40°C to +50°C Zone 22 AEx tc IIIB T105°C Dc Ta -40°C to +50°C	
D2xB1: X10DC048 X10AC115 X10AC230	Class I Zone 2 AEx ec IIC T2 Gc Ta -40°C to +50°C Zone 22 AEx tc IIIB T95°C Dc Ta -40°C to +50°C	
Installation must be carried out in compliance with the National Electric Code.		

#### CEC Class / Zone ratings Canada

Standards		
CAN/CSA C22.2 No. 60079-0 (Ed. 4) 02/2019 Explosive Atmospheres - Part 0: Equipment - General Requirements CAN/CSA C22.2 No. 60079-7 (Ed. 2) Explosive Atmospheres - Equipment Protection by Increased Safety "e" CAN/CSA C22.2 No. 60079-31 (Ed. 2) Explosive Atmospheres - Equipment Dust Ignition Protection by Enclosure "t"		
Rating		
D2xB1: X05DC024	Ex ec IIC T2 Gc X Ta -40°C to +50°C Ex tc IIIC T80°C Dc Ta -40°C to +50°C	
D2xB1: X10DC024	Ex ec IIC T1 Gc X Ta -40°C to +50°C Ex tc IIIC T105°C Dc Ta -40°C to +50°C	
D2xB1: X05DC048 X05AC115 X05AC230	Ex ec IIC T3 Gc X Ta -40°C to +50°C Ex tc IIIC T95°C Dc X Ta -40°C to +50°C	

**European Safety Systems Ltd.** Impress House, Mansell Road, Acton, London W3 7QH Document No. D211-00-201-IS Issue 2 29-11-2024

www.e2s.com Tel: +44 (0)208 743 8880 Sheet 2 of 6

D2xB1:	Ex ec IIC T2 Gc X Ta -40°C to +50°C
X10DC048	Ex tc IIIC T95°C Dc Ta -40°C to +50°C
X10AC115	
X10AC230	

Installation must be carried out in compliance with the Canadian Electric Code

#### 4) Zones, Gas Group, Category and **Temperature Classification**

When connected to an approved system the D2X beacon may be installed in:

Avec Classification			
	Area Classification		
Zone 2	Explosive gas air mixture not likely to occur in normal operation, and if it does, it will only exist for a short time.		
Zone 22	Explosive dust air mixture not likely to occur in normal operation, and if it does, it will only exist for a short time.		
	Gas Groupings		
Group IIA	Propane		
Group IIB	Ethylene		
Group IIC	Hydrogen and Acetylene		
Tempe	rature Classification for Gas Applications		
T1	450°C		
T2	300°C (Excluding D2xB1X10DC024)		
Т3	200°C (D2xB1X05DC048 & D2xB1X05AC only)		
	Dust Groupings (ATEX / IECEx / UKEX only)		
Group IIIA	Combustible Flyings		
Group IIIB	Non-conductive Dust		
Group IIIC Conductive Dust			
Maximum Surface Temperature for Dust Applications (ATEX / IECEx / UKEX only)			
D2xB1: X05DC024	80°C		
All 48VDC, 115VAC & 230VAC units	95°C		
D2xB1: X10DC024	105°C		
Equipment Category			
3G / 3D			
Equipment Level Protection			
Gc, Dc			
Ambient Temperature Range			
-40°C to +70°C			
IP Rating			

IP6X to EN/IEC60079-0 IP66 to EN60529

To maintain the ingress protection rating, the two off cable entries must be fitted with suitably rated, certified cable entry and/or blanking devices during installation.

#### Type Rating

Per UL50E / NEMA250: 4 / 4X / 3R / 13

#### 5) Special Conditions of Use

Special Condition for safe Use as stated on the Type Examination Certificate DEMKO 14 ATEX 4786493904X / CoC IECEx ULD 14.0004X / UL21UKEX2131X:

When used for a Group III application, the surface of the enclosure may store electrostatic charge and become a source of ignition in applications with a low relative humidity <~30% relative humidity where the surface is relatively free of surface contamination such as dirt, dust, or oil.

Guidance on protection against the risk of ignition due to electrostatic discharge can be found in EN TR50404 and IEC TR60079-32.

End user shall adhere to the manufacturer's installation and instruction when performing housekeeping to avoid the potential for hazardous electrostatic charges during cleaning, by using a damp cloth.

To maintain the ingress protection rating and mode of protection, the cable entries must be fitted with suitably rated, certified cable entry and/or blanking devices during installation.

#### 6) Product Mounting and Access

#### 6.1. Location and Mounting

The location of the beacon should be made with due regard to the area over which the warning signal must be visible. It should only be fixed to services that can carry the weight of the unit.

The D2x beacon should be secured to any flat surface using the two 7mm fixing holes in the feet of the base. The 2-off feet must first be fitted to the base using the 2-off M4 X 12mm countersunk screws provided. The unit can also be pole mounted using the 3/4" NPT Entry in the centre of the base. See Fig. 1.

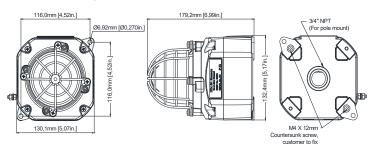


Fig. 1 Fixing Location for Beacon

#### 6.2. Access to the Enclosure



Warning - High voltage may be present, risk of electric shock. DO NOT open when energised, disconnect power before opening.



Warning – Hot surfaces. External surfaces and internal components may be hot after operation, take care when handling the equipment.

To access the enclosure, loosen the four M4 posi pan head screws and withdraw the cover.




Fig. 2 Accessing the Enclosure.

To replace cover, check that the 'O' ring seal is in place. Carefully push the cover in place. Insert M4 screws with fiber washers and tighten to 3Nm torque.

#### Selection of Cable. Cable Glands, Blanking **Elements & Adapters**

When selecting the cable size, consideration must be given to the input current that each unit draws (see Table 1), the number of sounders on the line and the length of the cable runs. The cable size selected must have the necessary capacity to provide the input current to all of the sounders connected to the line.

The entries can be ordered with one of the following options:

2-off M20 x 1.5 thread, 2-off 1/2" NPT thread & 1-off 3/4" NPT thread

If a high IP (Ingress Protection) rating is required then a suitable sealing washer must be fitted under the cable glands or blanking plugs.

For use in explosive dust atmospheres, a minimum ingress protection rating of IP6X must be maintained.

For use in explosive gas atmospheres, a minimum ingress protection rating of IP54 must be maintained.

NPT plugs should be greased before insertion.

#### 8) Cable Connections

Electrical connections are to be made into the terminal blocks on the PCBA located in the enclosure. See section 6 of this manual for access to the enclosure.

Wires having a cross sectional area between 0.5 mm<sup>2</sup> to 2.5mm2 can be connected to each terminal way. If an input and output wire is required the 2-off Live/Neutral or +/terminals can be used. If fitting 2-off wires to one terminal way the sum of the 2-off wires must be a maximum cross

sectional area of 2.5mm<sup>2</sup>. Strip wires to 8mm. Wires may also be fitted using ferrules. Terminal screws need to be tightened down with a tightening torque of 0.56 Nm / 5 Lb-in. When connecting wires to the terminals great care should be taken to dress the wires so that when the cover is inserted into the chamber the wires do not exert excess pressure on the terminal blocks. This is particularly important when using cables with large cross sectional areas such as 2.5mm<sup>2</sup>.

#### 9) Wiring

For further wiring schematics refer to document D211-06-201

#### 9.1. AC Wiring

3-off 2-way terminal blocks are provided on the AC beacon for power. There are 2-off Live, 2-off Neutral and 2-off Earth terminals in total.




Fig. 4 D2xB1X05/D2xB1X10 AC Terminals

#### 9.2. DC Wiring

3-off 2-way terminal blocks are provided on the AC beacon for power. There are 2-off +ve, 2-off -ve and 2-off Earth terminals in total.




Fig. 6a D2xB1X05/D2xB1X10 48 VDC Terminals




Fig. 6b D2xB1X05/D2xB1X10 24 VDC Terminals

#### 10) Line Monitoring (DC Units only)

On D2xB1X05/D2xB1X10 DC units, DC reverse line monitoring can be used if required. All DC beacons have a blocking diode fitted in their supply input lines. An end of line monitoring resistor can be connected across the +ve and -ve terminals. If an end of line resistor is used it must have the following values:

	Min. Resistance	Min. Power
24V DC	3.9ΚΩ	0.5W
	1ΚΩ	2W
48V DC	15ΚΩ	0.5W
	3.9ΚΩ	2W

The resistor must be connected directly across the +ve and -ve terminals as shown in the following drawing. Form the resistor legs as shown in Fig. 8a, remove the +ve and -ve terminal plugs and fit the resistor across the two terminal plugs before refitting them to the PCBA as shown in Fig. 8a or 8b. A spacing of at least 1/16" (1.58mm) must be provided through air and over surfaces between uninsulated live parts.




Fig. 7 End of Line Resistor Forming

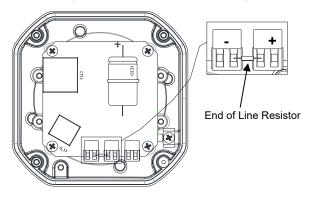


Fig. 8a End of Line Resistor Placement (D2xB1DC048)

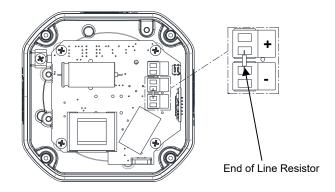


Fig. 8b End of Line Resistor Placement (D2xB1DC024)

#### 11) Interchangeable & Spare Parts



Warning - Hot surfaces. External surfaces and internal components may be hot after operation, take care when handling the equipment.

The Beacon lens cover is interchangeable, contact E2S Ltd for a replacement lens cover available in various colours.

To change the lens cover, unscrew the 4-off M5 posi pan head screws, spring and flat washers using a screwdriver. Remove the wire guard and replace the old lens cover with the new lens cover.




Fig. 9 Replacement of beacon lens cover

Fit the wire guard back onto the housing, over the new lens cover aligning the fixing holes of the guard, lens cover and housing. Refit the fixings to hold into place, the fixings MUST be fitted in the order shown above.

#### 12) DIP Switch

Please note that the D2xB1X05DC024 & D2xB1X10DC024 beacon PCBAs have a DIP Switch that is NOT customer configurable. This should only ever be set to '00'.




Fig. 7 DIP Switch setting '00'

#### 13) Maintenance, Overhaul & Repair

Maintenance, repair and overhaul of the equipment should only be carried out by suitably qualified personnel in accordance with the current relevant standards:


	Explosive atmospheres - Equipment repair, overhaul and reclamation
EN 60079-17 IEC60079-17	Explosive atmospheres - Electrical installations inspection and maintenance

To avoid a possible ELECTROSTACTIC CHARGE the unit must only be cleaned with a damp cloth.

Units must not be opened while an explosive atmosphere is present.

If opening the unit during maintenance operations a clean environment must be maintained and any dust layer removed prior to opening the unit.

Sheet 6 of 6

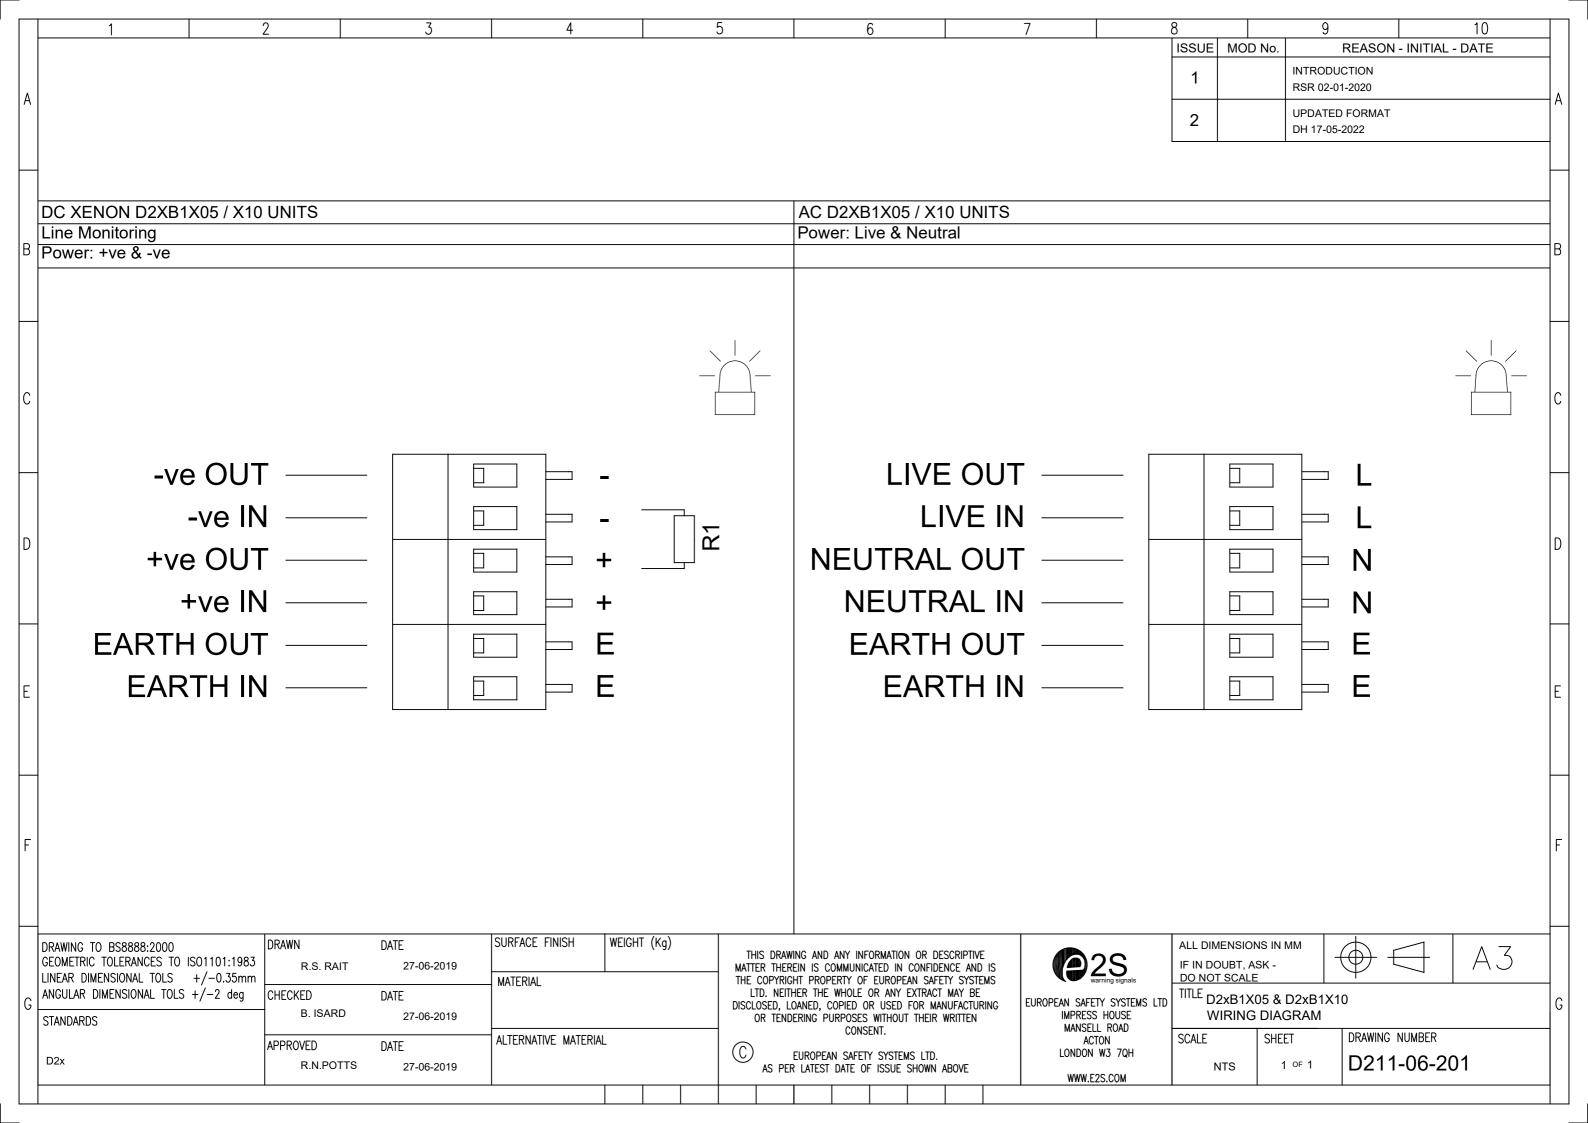

## **EU Declaration of Conformity**



Manufacturer: European Safety Systems Ltd.

Impress House, Mansell Road, Acton

London, W3 7QH United Kingdom

Authorised Representative: E2S Warnsignaltechnik UG

Charlottenstrasse 45-51

72764 Reutlingen

Germany

Equipment Type: D2xS1, D2xS2, D2xL1, D2xL2, D2xC1X05, D2xC1X10

D2xB1X05, D2xB1X10, D2xB1LD2, D2xB1XH1, D2xB1XH2, D2xB1LD3 D2xC2X05, D2xC2X10, D2xC2LD2, D2xC2XH1, D2xC2XH2, D2xC2LD3

D2xJ1

<u>Directive 2014/34/EU: Equipment and Protective Systems for use in Potentially Explosive Atmospheres (ATEX)</u>

Notified Body for EU type Examination (Module B): UL International Demko A/S

Notified Body No.: 0539

Borupvang 5A, 2750 Ballerup, Denmark

EU-type Examination Certificate (Module B): DEMKO 14 ATEX 4786493904X

Notified Body for Quality Assurance Notification / Conformity to EU-type

based on

Sira Certification Service Notified Body No.: 2813

quality assurance of the production process (Module D):

CSA Group Netherlands B.V, Utrechtseweg 310, 6812 AR, Arnhem, Netherlands

Quality Assurance Notification (Module D): SIRA 05 ATEX M342

Provisions fulfilled by the equipment: II 3G Ex ec IIC T6/T5/T4A/T4/T3C/T3/T2/T1 Gc

II 3D Ex tc IIIC T55/75/80/85/90/93/95/105/109/110/119°C Dc

Ingress / Dust Protection to EN60079-0 / EN60079-31:

IP66

Standards applied: EN IEC 60079-0:2018

EN IEC 60079-7:2015 +A1:2018

EN 60079-31:2014

Directive 2014/30/EU: Electromagnetic Compatibility Directive (EMC)

Standards applied: EN 61000-6-1:2007

EN 61000-6-2:2005

EN 61000-6-3:2007 / A1:2011 / AC: 2012

EN 61000-6-4:2007 / A1: 2011

Directive 2011/65/EU: Restriction of the use of certain hazardous substances in electrical and electronic equipment (ROHS)

The product and all the components contained within it are in accordance with the restriction of the use of hazardous substances in electrical and electronic equipment, including amendment by Directive 2015/863/EU.

## **EU Declaration of Conformity**



Regulation (EC) 1907/2006: Registration, Evaluation, Authorisation and Restriction of Chemicals (REACH)

The product and all the components contained within it are free from substances of very high concern.

Other Standards and Regulations

EN 60529:1992+A2:2013 - Degrees of protection provided by enclosures (IP code) – enclosure rated:

IP66 All units

IP66/67 D2xL1, D2xL2, D2xS2 only

On behalf of European Safety Systems Ltd., I declare that, on the date the equipment accompanied by this declaration is placed on the market, the equipment conforms with all technical and regulatory requirements of the above listed directives, regulations and standards.

This Declaration is issued under the sole responsibility of the manufacturer.

Martin Streetz

Quality Assurance Manager

Document No.: DC-061\_Issue\_K
Date and Place of Issue: London, 04/12/2023



## UKCA Declaration of Conformity



Manufacturer: European Safety Systems Ltd.

Impress House, Mansell Road, Acton

London, W3 7QH United Kingdom

Equipment Type: D2xS1, D2xS2, D2xL1, D2xL2, D2xC1X05, D2xC1X10

D2xB1X05, D2xB1X10, D2xB1LD2, D2xB1XH1, D2xB1XH2, D2xB1LD3 D2xC2X05, D2xC2X10, D2xC2LD2, D2xC2XH1, D2xC2XH2, D2xC2LD3

D2xJ1

<u>Directive UKSI 2016:1107 (as amended by UKSI 2019:696) – Schedule 3A, Part 1: Product or Protective System Intended for use in Potentially Explosive Atmospheres (UKCA)</u>

Notified Body for UK type Examination (Module B): UL International (UK) Ltd

Notified Body No.: 0843

Unit 1-3 Horizon Kingsland Business Park, Wade Road,

Basingstoke, Hampshire RG24 8AH UK

UK-type Examination Certificate (Module B): UL21UKEX2131X

Notified Body for Quality Assurance Notification / Conformity to EU-type Sira Certification Service

based on

Notified Body No.: 0518

quality assurance of the production process (Module D): Rake Lane, Eccleston, Chester CH4 9JN, UK

Quality Assurance Notification (Module D): CSAE 22UKQAN0046

Provisions fulfilled by the equipment: II 3G Ex ec IIC T6/T5/T4A/T4/T3C/T3/T2/T1 Gc

II 3D Ex tc IIIC T55/75/80/85/90/93/95/105/109/110/119°C Dc

Ingress / Dust Protection to EN60079-0 / EN60079-31:

IP66 All units

Standards applied: EN IEC 60079-0:2018

EN IEC 60079-7:2015 +A1:2018

EN 60079-31:2014

Directive 2014/30/EU: Electromagnetic Compatibility Directive (EMC)

Standards applied: EN 61000-6-1:2007

EN 61000-6-2:2005

EN 61000-6-3:2007 / A1:2011 / AC: 2012

EN 61000-6-4:2007 / A1: 2011

Directive 2011/65/EU: Restriction of the use of certain hazardous substances in electrical and electronic equipment (RoHS)

The product and all the components contained within it are in accordance with the restriction of the use of hazardous substances in electrical and electronic equipment, including amendment by Directive 2015/863/EU.



# UKCA Declaration of Conformity



Regulation (EC) 1907/2006: Registration, Evaluation, Authorisation and Restriction of Chemicals (REACH)

The product and all the components contained within it are free from substances of very high concern.

Other Standards and Regulations

EN 60529:1992+A2:2013 - Degrees of protection provided by enclosures (IP code) – enclosure rated:

IP66 All units

IP66/67 D2xL1, D2xL2, D2xS2 only

On behalf of European Safety Systems Ltd., I declare that, on the date the equipment accompanied by this declaration is placed on the market, the equipment conforms with all technical and regulatory requirements of the above listed directives, regulations and standards.

This Declaration is issued under the sole responsibility of the manufacturer.

Martin Streetz **Quality Assurance Manager**  Document No.: Date and Place of Issue:

DC-102\_Issue\_B London, 04/12/2023