


INSTRUCTION MANUAL

GNExCP7-PB-I, GNExCP7-PB-IR, GNExCP7-PM-I, GNExCP7-PM-IR


GNExCP7-PT-I, GNExCP7-PT-IR Intrinsically Safe Call Point

Class I Div 1 ; UL60947

NEC / CEC / ATEX / IECEx / UKEx Zone 0, 1, 2

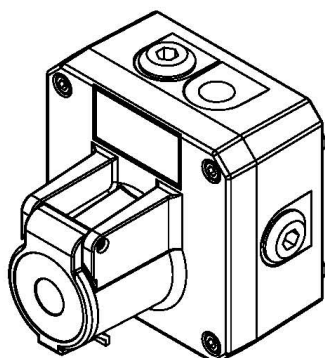

GNExCP7-PM & GNExCP7-PT

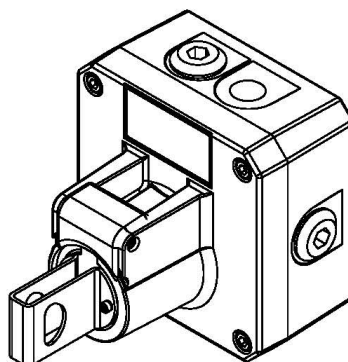

GNExCP7-PB

1) Product Table

Unit Type Code	Input Parameters		
GNExCP7-PB-I GNExCP7-PB-IR	Ui	=	30V
	Ii	=	500mA
GNExCP7-PM-I GNExCP7-PM-IR	Pi	=	1100mW
	Ci	=	0
	Li	=	0
GNExCP7-PT-I GNExCP7-PT-IR			

Table 1: Electrical Ratings

2) Warnings



WARNINGS:

- DO NOT OPEN WHEN AN EXPLOSIVE ATMOSPHERE IS PRESENT
- DO NOT OPEN WHEN ENERGISED
- ELECTROSTATIC CHARGING HAZARD – CLEAN ONLY WITH A DAMP CLOTH.

AVERTISSEMENT:

- NE PAS OUVRIR UN PRESENCE D'ATMOSPHERE EXPLOSIVE
- NE PAS OUVRIR ENERGIE
- DANGER POTENTIEL CHARGE ÉLECTROSTATIQUE - NETTOYER UNIQUEMENT AVEC UN CHIFFON HUMIDE

3) Marking & Rating Information

The GNEExCP7-PB, -PM & -PT Call Points comply with the following standards for hazardous locations:

3.1 Class/Division Ratings for US & Canada

Standards	
UL 60079-0:2020 (Ed 7): Explosive Atmospheres - Part 0: Equipment - General requirements UL 60079-11:2023 (Ed6): Explosive Atmospheres - Part 1: Equipment protection by Intrinsic Safety CSA C22.2 NO. 60079-0: 2019 (Ed 4) Explosive Atmospheres – Part 0: Equipment – General requirements CSA C22.2 NO. 60079-11:2014 (Ed 3): Explosive Atmospheres – Part 11: Equipment protection by Intrinsic Safety	
Class Division Ratings for US (NEC) & Canada (CEC)	
Model No:	Rating
GNEExCP7-PB-I GNEExCP7-PM-I GNEExCP7-PT-I	Class I Div 1 Group ABCD T6 Ta -55°C to +70°C
GNEExCP7-PB-IR GNEExCP7-PM-IR GNEExCP7-PT-IR	Class I Div 1 Group ABCD T4 Ta -55°C to +70°C
Class Zone Ratings for US (NEC)	
Model No:	Rating
GNEExCP7-PB-I GNEExCP7-PM-I GNEExCP7-PT-I	Class I Zone 0 AEx ia IIC T6 Ga Ta -55°C to +70°C
GNEExCP7-PB-IR GNEExCP7-PM-IR GNEExCP7-PT-IR	Class I Zone 0 AEx ia IIC T4 Ga Ta -55°C to +70°C
Class Zone Ratings for Canada (CEC)	
Model No:	Rating
GNEExCP7-PB-I GNEExCP7-PM-I GNEExCP7-PT-I	Ex ia IIC T6 Ga Ta -55°C to +70°C
GNEExCP7-PB-IR GNEExCP7-PM-IR GNEExCP7-PT-IR	Ex ia IIC T4 Ga Ta -55°C to +70°C
Installation must be carried out in compliance with the National Electric Code / Canadian Electric Code	


3.2 ATEX / IECEx & UKEx Ratings

Standards	
EN60079-0:2018/IEC60079-0:2017 (ed.7): Explosive Atmospheres - Equipment General Requirements. EN60079-11:2012/IEC60079-11:2019 (ed.6): Explosive Atmospheres - Equipment Protection by Intrinsically Safe Enclosures "ia".	
Model No:	Rating
GNEExCP7-PB-I GNEExCP7-PM-I GNEExCP7-PT-I	Ex ia IIC T6 Ga Ta -55°C to +70°C
GNEExCP7-PB-IR GNEExCP7-PM-IR GNEExCP7-PT-IR	Ex ia IIC T4 Ga Ta -55°C to +70°C
See Product table for electrical ratings of each unit model	

Certificate No.

DEMKO 19 ATEX 2101X
IECEX ULD 19.0007X
UKEx UL UL21UKEX2134X

Epsilon x
Equipment Group
and Category:



CE Marking and
Notified Body No.



UKCA Marking and
Notified Body No.



3.3 DNV Type Approval

The units have been tested and approved for the installation on ships in the following locations:

- Temperature:** Class A,B,C & D (all locations including open decks and masts)
- Humidity:** Class A & B (all locations)
- Vibration:** Class A (all locations except installation on machinery such as combustion engines, compressors, pumps, including piping on such machinery)
- EMC:** Class A & B (all locations including open decks and bridge)
- Enclosure:** Class A, B & C – IP56 (all locations except submerged applications and bilges)

3.4 UL 60947 Approval



All models are approved for use as Alarm System use:

UL 60947-4-1 LOW-VOLTAGE SWITCHGEAR AND CONTROLGEAR - PART 4-1: CONTACTORS AND MOTORSTARTERS - ELECTROMECHANICAL CONTACTORS AND MOTOR-STARTERS- Edition 3 - Revision Date 2017/10/17

CSA C22.2 NO. 60947-4-1-14 LOW-VOLTAGE SWITCHGEAR AND CONTROLGEAR — PART 4-1: CONTACTORS AND MOTOR-STARTERS — ELECTROMECHANICAL CONTACTORS AND MOTOR-STARTERS- Edition 2 - Issue Date 2014/01/04

UL 60947 Ambient Temperature Range: -55°C to +60°C

For Indoor and Outdoor Use
Pour usage Interieur INTÉRIEUR

4) Zones, Gas Group, Category and Temperature Classification

The units can be installed in locations with the following conditions:

Area Classification Gas	
Zone 0	Explosive gas air mixture continually present in normal operation.
Zone 1	Explosive gas air mixture likely to occur in normal operation.
Zone 2	Explosive gas air mixture not likely to occur in normal operation, and if it does, it will only exist for a short time.
Gas Groupings	
Group IIA	Propane
Group IIB	Ethylene
Group IIC	Hydrogen and Acetylene
Temperature Classification for Gas Applications	
T1	450° C
T2	300° C
T3	200° C
T4	135° C
T5	100°C (GNEExCP7-PB-I , PM-I, PT-I) only
T6	85°C (GNEExCP7-PB-I , PM-I, PT-I) only
Equipment Category	
1G	
Equipment Protection Level	
Ga, Gb, Gc	
Ambient Temperature Range	
-55°C to +70°C (-67°F to +158°F) ATEX/IECEX/UKEx	
IP Rating	
IP66 to EN60529 4 / 4X / 3R / 13 to UL50E / NEMA250	

5) Specific Conditions for Safe Use

The equipment has a maximum capacitance of 6.33pF.

The equipment does not provide 500V isolation between the intrinsically safe circuit and parts which may be earthed. This shall be considered in the end-use application to ensure the possibility of an earth connection will not compromise intrinsic safety.

Use galvanically isolating barriers or ensure that the installation is equipotentially bonded such that earth loops can not occur.

Refer to EN/IEC 60079-14.

Equipment is permitted to be wall mounted only in vertical position. The enclosure base is permitted in two mounting positions, with the double entry lowermost or uppermost.

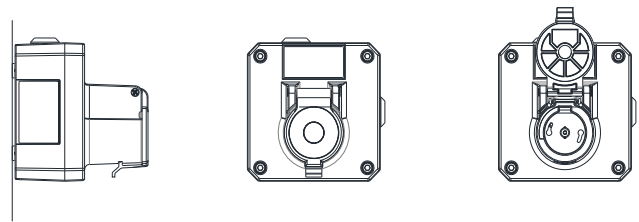


Fig 1 Wall Mounting

6) Location and Mounting

The location of the call point should enable ease of access for operation and testing. The unit should be mounted using the 4 off fixing holes which will accept up to M5 sized fixings. They should only be fixed to services that can carry the weight of the unit.

To gain access to the mounting holes in the base the front cover must be removed. See Section 7

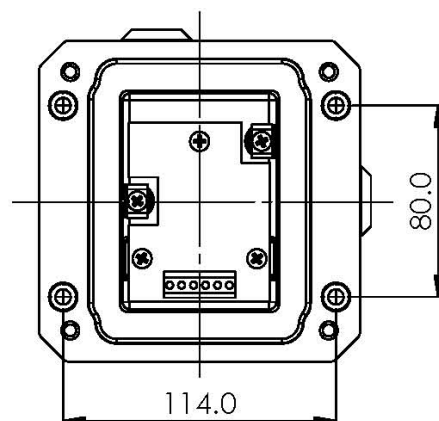


Fig. 1 View of base unit showing fixing centres (in mm).

7) Access to the Enclosure



Warning – High voltage may be present, risk of electric shock. DO NOT open when energised, disconnect power before opening.

Warning – Hot surfaces. External surfaces and internal components may be hot after operation, take care when handling the equipment.

To access the chamber, remove the four off M6 x 50 hexagon socket head screws and carefully withdraw the cover.

Once the screws are removed the cover will hang down out of the way to gain access to the terminals, the internal earth terminal and mounting hole recesses.

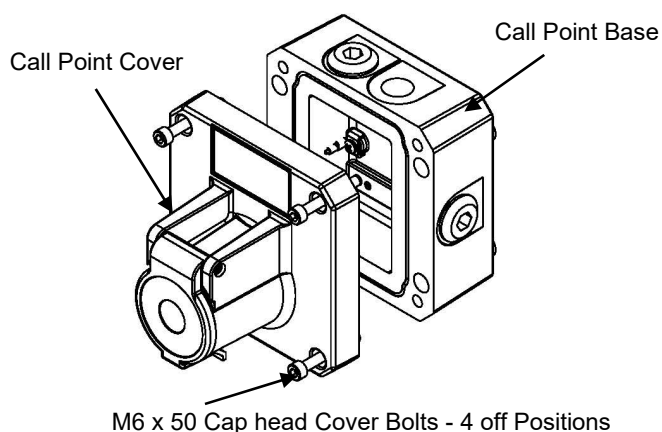


Fig. 2 Accessing the Enclosure.

Check that the earth bonding wire between the two castings is secure and the 'O' ring seal is in place.

When replacing the cover casting ensure that it is square with the chamber casting before inserting. Carefully place the cover on the base. Only after the cover is fully in place should the four M6 x 60 cover bolts and their spring washer be tightened down. Never use the cover bolts to force the cover into position.

8) Earthing

The units are provided with internal and external earth terminals which are mounted in the base of the unit.

Internal earthing connections should be made to the Internal Earth terminal in the base of the housing using a ring crimp terminal to secure the earth conductor under the earth clamp.

The earth conductor should be at least equal in size and rating to the incoming power conductors.

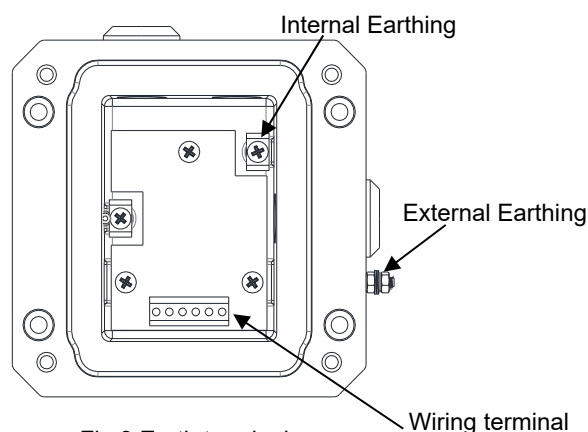


Fig 3 Earth terminals

9) Power Supply Selection Electrical Ratings

Input terminals and Zener Barrier or Galvanic Isolator

Power is supplied to the call point via the + and - terminals. All terminals have the following input safety parameters:

U_i	=	30V
I_i	=	500mA
P_i	=	1100mW
C_i	=	0
L_i	=	0

The unit may be powered from an ATEX/IECEX/UKEx certified Zener barrier or galvanic isolator which have output parameters equal to or less than 30V, 500mA and 1100mW, where I_o is resistively limited. The cable parameters stated on the selected Zener barrier or galvanic isolator certificate must be observed.

10) Selection of Cable. Cable Glands, Blanking Elements & Adapters

ATEX/IECEX & UKEx Installations:

The equipment must only be installed by suitably qualified personnel in accordance with the latest issues of the relevant standards:

EN60079-14 / IEC60079-14: Explosive atmospheres - Electrical installations design, selection and erection

EN60079-10-1 / IEC60079-10-1: Explosive atmospheres - Classification of areas. Explosive gas atmospheres

The installation of the units must also be in accordance with any local codes that may apply and should only be carried out by a competent electrical engineer who has the necessary training.

For high ambient temperatures the cable entry temperature may exceed +70°C or the cable branching point temperature may exceed 80°C and therefore suitable heat resisting cables and cable glands must be used, with a rated service temperature of at least the values stated below:

For models GNExCP7-PB-I, PM-I, PT-I:

Max. ambient temperature °C	50	55	60	65	70
req. Cable / Cable Gland rating: °C	76	81	86	91	96

For models GNExCP7- PB-IR, PM-IR, PT-IR:

Max. ambient temperature °C	40	45	50	55	60	65	70
req. Cable / Cable Gland rating: °C	85	90	95	100	105	110	115

NEC / CEC Installations:

The installation of the units must also be in accordance with any local codes that may apply and should only be carried out by a competent electrical engineer who has the necessary training. In compliance with the National Electrical Code NFPA 70 or Canadian Electric Code CSA22.1

For high ambient temperatures the cable entry temperature may exceed +60°C or the cable branching point temperature may exceed 60°C and therefore suitable heat resisting cables and cable glands must be used, with a rated service temperature of at least the values stated below:

For model GNExCP7- PB-I, PM-I, PT-I:

Max. ambient temperature °C	35	40	45	50	55	60
req. Cable / Cable Gland rating: °C	61	66	71	76	81	86

For model GNExCP7- PB-IR, PM-IR, PT-IR:

Max. ambient temperature °C	20	25	30	35	40	45	50	55	60
req. Cable / Cable Gland rating: °C	65	70	75	80	85	90	95	100	105

All Installations:

The enclosure is non-conducting and may generate an ignition-capable level of electrostatic charges under certain extreme conditions. The user should ensure that the equipment is not installed in a location where it may be subjected to external conditions that might cause a build-up of electrostatic charges on non-conducting surfaces.

The M12 Cap fitted to the top side of the unit is not a user serviceable part and must not be removed during installation and maintenance.

The cable gland entries have an M20 x 1.5 entry thread. Glands to be rated to IP66 (tightening torque 10Nm).

When only one cable entry is used the other entries must be closed with plugs to be rated to IP66 (tightening torque 10Nm).

Electrical connections are to be made into the PCB / terminal blocks / DIN rail provided.

The GNExCP7 Call Point range can be supplied with the following types of adapters:

- M20 to ½" NPT
- M20 to ¾" NPT
- M20 to M25

It is important to note that stopping plugs cannot be fitted onto adapters, only directly onto the M20 entries.

11) Cable & Wiring Connections

The units come with two options.

A DIN rail version which has 4-way connection and allows for the wiring of switches only.

Models : GNExCP7-PB-I ; PM-I & PT-I

For full wiring details see wiring diagrams D202-06-501

The PCB Terminal Version has a 6-way connector but is designed to allow for full customer configuration with Series

and EOL devices in a number of wiring configurations. E2S can also configure unit at time of order to E2S

Models : PB-IR ; PM-IR & PT-IR

For full wiring details see wiring diagrams D202-06-502

For EOL and Series device limitations and configurations see Section 15. Fitting can be requested by E2S at the order stage or added to the correct terminal blocks afterward. All devices must comply with the requirements stipulated in section 13.

Electrical Connections are to be made into the terminal blocks using solid or stranded wire.

Wires having a cross sectional area between 0.5 mm² to 2.5mm² (AWG 20 – 14) can be connected to each terminal way.

In most configuration an input and output wire can be fitted to individual terminals, where these are more complex and if fitting 2-off wires to one terminal way, the sum of the 2-off wires must be a maximum cross sectional area of 2.5mm².

Strip wires to 8mm. Wires may also be fitted using ferrules.

DIN Rail Terminals: 0.51 Nm / 4.5 Lb-in;

PCBA Main Terminals: 0.45 Nm / 4.0 Lb-in;

PCBA EOL and Series (1 & 2) Terminals: 0.38 Nm / 3.4 Lb-in

When connecting wires to the terminals great care should be taken to dress the wires so that when the cover is inserted into the chamber the wires do not exert excess pressure on the terminal blocks. This is particularly important when using cables with large cross-sectional areas such as 2.5mm².

12) Testing unit operation

The push button types -PB -PT and -PM are all operated by pressing in the main plunger down activating the switch.

PB – Dual Action Push Button

The -PB plunger needs to be firstly twisted by 90 degrees clockwise to position shown and then pressed in. There will be a click sound to indicate positive engagement and the plunger will stay in place.

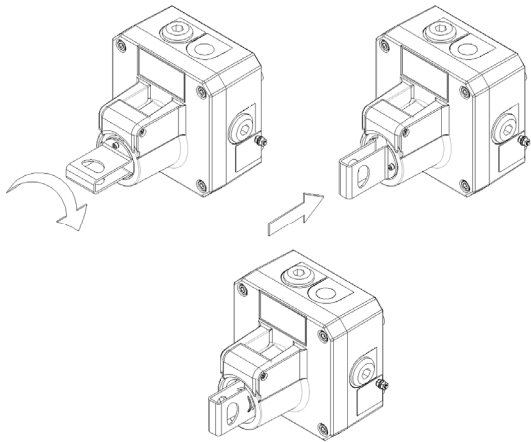


Fig 6 -PB Version Twist and Push Action

On -PB versions, the plunger will remain in position until the unit is reset. This is done by pulling the plunger back up to

the start position shown in fig 6. Then the plunger is twisted back 90 degrees anti-clockwise to the stop.

PM – Momentary Push Button

The -PM needs to have the protective flip lid opened first and then the main plunger pressed in. There will be a click sound to indicate positive engagement, the plunger will spring back up if not held pressed.

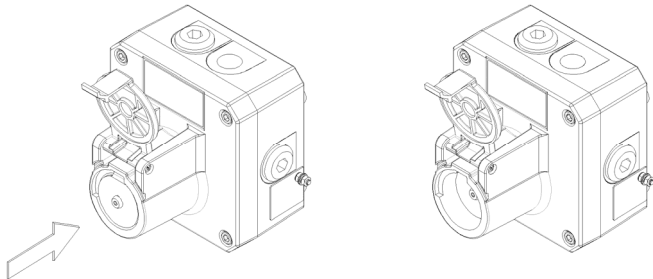


Fig 7 -PM Version Push Action

On -PM versions the operation is momentary and as such the plunger will reset automatically once the pressure on the plunger is released.

PT – Tool Reset Push Button

The -PT needs to have the protective flip lid opened first and then the main plunger pressed in. There will be a click sound to indicate positive engagement and the plunger will stay in place.

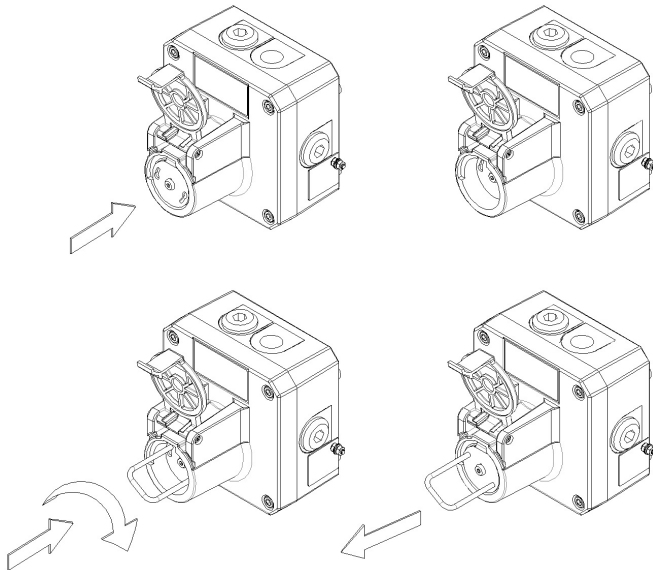


Fig 8a -PT Version Push Action

To reset, insert the reset tool supplied with the unit into the 2-off holes in the button plate, rotate clockwise along the curved slots and then pull the button plate back up. Rotate the tool anti clockwise and remove through the 2-off holes in the button plate.

13) End-of-Line and Series Devices


All GNExCP7-BG-IR models can be fitted with series / end-of-line monitoring resistors, monitoring diodes and Zener and also LED options into the terminals of the units with the PCB terminal option.

Min. device values and current limitations must be observed depending on supply voltage and type of components fitted. If a combination of resistors / diodes / zener diodes or LED is used, values for all components must be observed and lowest current limit for either component becomes overall limit.

Current limitation for units fitted with end-of-line or series resistors, diodes or zener diodes must be ensured by using a current limited power supply or fitting a current limiting resistor at the control panel (not provided).

When fitting EOL or series device into the applicable terminal ensure the component is bent to the following specification to ensure the correct creepage and clearance is maintained.

Depending on the wiring option required either of these component lead bending configurations is suitable.

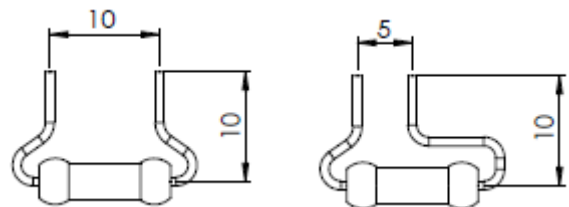

EOL or Series device
Component Lead Bending

EOL only for alternative EOL wiring
Component Lead Bending

The following table 2 shows limitations for all possible variations:

Supply voltage 24Vdc Nom 30Vdc Max via barriers.		
Type of component fitted	value	Max. current (mA)
End-of-Line Resistor 5% Max tolerance. Ø3.5 x 9.0mm – 2W Ø2.6 x 6.8mm – 0.5W Min component size	min. 470R / 2W or min. 2k2 / 0.5W	N/A Barrier limit
End-of-Line Diode Type 1N5401 Ø4.8 x 7.2mm Min component size	2W	59.13 customer to limit
Series Resistor 5% Max Tolerance. Ø3.5 x 9.0mm – 2W Ø2.6 x 6.8mm – 0.5W Min component size	min. 470R / 2W or min. 2k2 / 0.5W	N/A Barrier limit
Series Diode Type 1N5401 Ø4.8 x 7.2mm Min component size	2W	59.13 customer to limit
Series Zener Diode Type 1N53xxB Ø3.3 x 8.4mm Min component size	3.3V	230 customer to limit
	4.7V	162 customer to limit
	5.1V	149 customer to limit
	5.6V	136 customer to limit
	6.2V	122 customer to limit
	6.8V	112 customer to limit
	10V	76 customer to limit
	12V	63 customer to limit

EOL (End of line) device;

- resistor – ExxxR
- diode – ED1
- zener – ExxxZ

Series (In line) device;

- resistor – SxxxR
- diode – SD1
- zener – SxxxZ
- LED

Microswitch 1 = M/S 1

Microswitch 2 = M/S 2

The unit can be wired with a maximum of 4 module & LED devices – see wiring diagram D202-06-502

An optional LED monitoring module is designated after the model no as either,


To include an LED and power limiting resistor (-L)

or,

Optional LED but where the units current must be limited to 20mA. As the LED has no power limiting resistor (-C)

The optional Ex d LED monitoring module is fitted in the M20x1.5 side entry as shown, when the main M20x1.5 entries are at the bottom of unit.

Wire LED into the Series terminals block, on the PCB, if fitting with an additional series resistor ferrule each lead together.

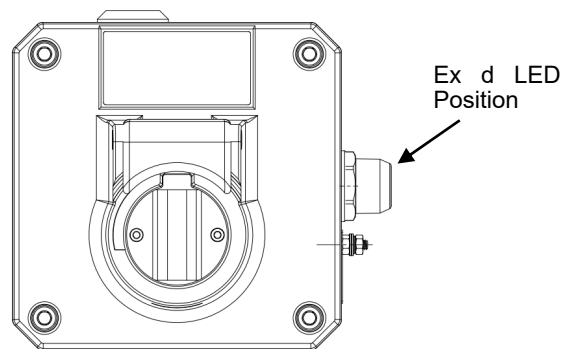

14) Maintenance, Overhaul, Repair and Cleaning

Maintenance, repair and overhaul of the equipment should only be carried out by suitably qualified personnel in accordance with the current relevant standards:

For ATEX / IECEx / UKEx

EN 60079-19 Explosive atmospheres – Equipment
IEC 60079-19 repair, overhaul and reclamation

EN 60079-17 Explosive atmospheres – Electrical
IEC 60079-17 installations inspections and maintenance

For US & CEC Class / Div / Zone

UL 60079-19 Explosive atmospheres - Equipment repair, overhaul and reclamation

UL 60079-17 Explosive atmospheres - Electrical
installations inspection and maintenance

All Installations:

Electrostatic charging hazard – clean only with a damp cloth.

Units must not be opened while an explosive atmosphere is present.

Live maintenance is not permitted.

15) SIL 2 Reliability Data

Reliability and Functional safety IEC/EN61508 which has been assessed and is considered suitable for use in low demand safety function:

- Random Hardware Failures and Systematic Failures (route 2H)
- As an unvoted item (i.e. hardware fault tolerance of 0) at SIL 2

The product was assessed against failure modes:

- Failure to close a contact when the call point is struck with specified force
- Failure to open a contact when the call point is struck with specified force
- Spurious output despite no input

Integrity in respect of failure to close	SIL 2
System Type	A
Hardware Fault Tolerance	0
Safe Failure Fraction (credible claim)	75%
PFD (hazardous failure)	2.3×10^{-3}
Proof Test Interval	Up to 1 year

16) Electrical System Design For Installation In Hazardous Areas Using Zener Barriers

ATEx/IECEX & UKEx Installations:

16.1 Single Input Barrier

Where the call point switch uses a Zener barrier, as shown in Fig below.

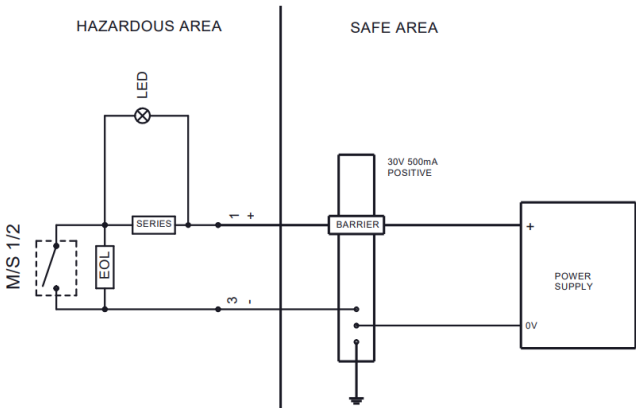


Fig. Single stage call point alarm using single barrier.

NEC /CEC Installations:

16.2 Single Input Barrier

Where the call point switch uses a Zener barrier, as shown in Fig below.

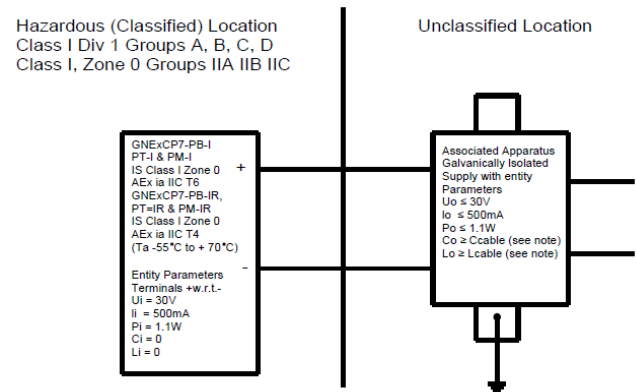


Fig. Single stage call point alarm using single barrier.

1. Associated apparatus output current must be limited by a resistor such that the output voltage current plot is a straight line drawn between open-circuit voltage and short-circuit current.

2. Installed should be in accordance with its manufacturer's control drawing and Article 504 of the National Electrical Code (ANSI/NFPA 70) for Canadian installation in the United States, or Section 18 of the Electrical Code for installations in Canada.
3. Where the cable capacitance and inductance per foot are not known, the following values shall be used: C_{able} = 60 pF/ft., L_{able} = 0.2 μH/ft.
4. When required by the manufacturer's control drawing, the associated apparatus must be connected to a suitable ground electrode per the National Electrical Code (ANSI/NFPA 70), the Canadian Electrical Code, or other local installation codes, as applicable. The resistance of the ground path must be less than 1 ohm.

17) Electrical System Design For Installation In Hazardous Areas Using Galvanic Isolators

Galvanic isolators do not require a high integrity earth connection. For small systems where a high integrity earth is not already available, the use of galvanic isolators often reduces the overall installation cost and simplifies design.

ATEx/IECEX & UKEx Installations:

17.1 Single Input Barrier

Where the call point switch uses a single Zener barrier, as shown in Fig below.

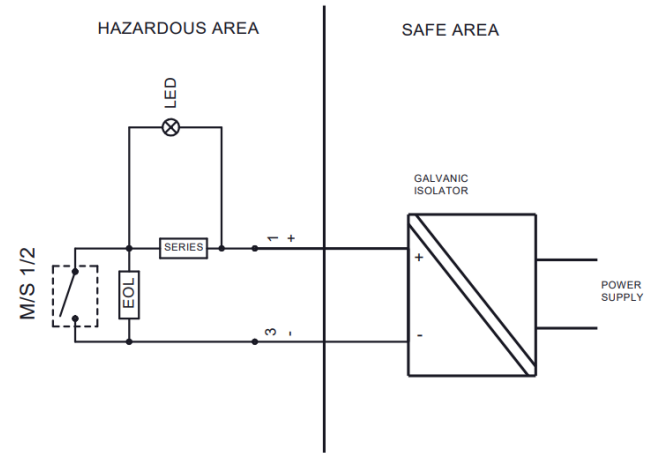


Fig. Single stage call point alarm using single galvanic isolator.

NEC /CEC Installations:

17.1 Single Input Barrier

Where the call point switch uses a single Zener barrier, as shown in Fig below.

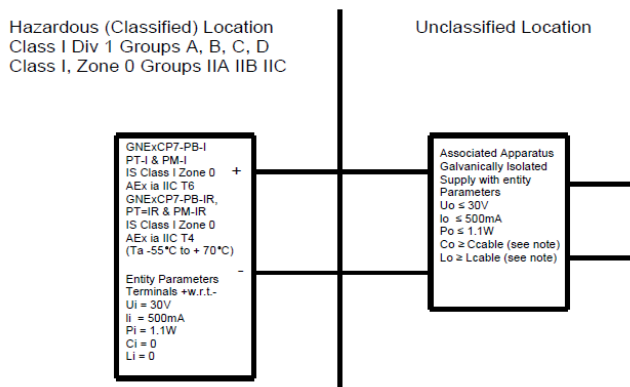


Fig. Single stage call point alarm using single galvanic isolator.

1. Associated apparatus output current must be limited by a resistor such that the output voltage current plot is a straight line drawn between open-circuit voltage and short-circuit current.
2. Installed should be in accordance with its manufacturer's control drawing and Article 504 of the National Electrical Code (ANSI/NFPA 70) for installation in the United States, or Section 18 of the Canadian Electrical Code for installations in Canada.
3. Where the cable capacitance and inductance per foot are not known, the following values shall be used: $C_{cable} = 60 \text{ pF/ft.}$, $L_{cable} = 0.2 \text{ μH/ft.}$

1		2		3		4		5		6		7		8		9		10			
SINGLE MICROSWITCH DEVICES						SHEET 1						ISSUE		MOD No.		REASON - INITIAL - DATE					
PRODUCTS: GNExCP7, STExCP8						GNEXCP7-BG[s][t][l][e][m][d][v][o][x][u]-[v][e][s] Series										1		Introduction RNP 02-02-2024			
						Switch Type [s]		Terminals [t]		Product Version [v]		Product Option [o]		LED Indicator [u]		EOL Module [e]		Module [s]			
SINGLE SWITCH				CONFIG. D1-1		DUAL SWITCH WITH EOL DEVICE				CONFIG. D1-2											
SWITCH TYPE [s] TERMINALS [t] PRODUCT OPTION [o] LED INDICATOR [u]				[S] [D] [1] [N]		Single DIN Rail Default NO LED				SWITCH TYPE [s] TERMINALS [t] PRODUCT OPTION [o] LED INDICATOR [u]		[D] [D] [1] [N]		Dual DIN Rail Parallel Wiring No LED							
Circuit shown in Unoperated condition						Circuit shown in Unoperated condition															
Unoperated condition (Glass Intact / Standby Condition) Terminals +(1) & -(4) open Terminals +(2) & (3) closed						Unoperated condition (Glass Intact / Standby Condition) Terminals +(1) & -(4) open Terminals +(2) & (3) closed															
Operated condition (Glass Broken / Button pushed in) Terminals +(1) & -(4) closed Terminals +(1) & (3) open						Operated condition (Glass Broken / Button pushed in) Terminals +(1) & -(4) closed Terminals +(1) & (3) open															
DRAWING TO BS8888:2000 GEOMETRIC TOLERANCES TO ISO1101:1983 LINEAR DIMENSIONAL TOLS ANGULAR DIMENSIONAL TOLS		DRAWN R.S.RAIT DATE 02-02-2024		SURFACE FINISH		WEIGHT (Kg)		THIS DRAWING AND ANY INFORMATION OR DESCRIPTIVE MATTER THEREIN IS COMMUNICATED IN CONFIDENCE AND IS THE COPYRIGHT PROPERTY OF EUROPEAN SAFETY SYSTEMS LTD. NEITHER THE WHOLE OR ANY EXTRACT MAY BE DISCLOSED, LOANED, COPIED OR USED FOR MANUFACTURING OR TENDERING PURPOSES WITHOUT THEIR WRITTEN CONSENT. EUROPEAN SAFETY SYSTEMS LTD. AS PER LATEST DATE OF ISSUE SHOWN ABOVE						 EUROPEAN SAFETY SYSTEMS LTD IMPRESS HOUSE MANSELL ROAD ACTON LONDON W3 7QH WWW.E2S.COM		ALL DIMENSIONS IN MM IF IN DOUBT, ASK - DO NOT SCALE				A3	
STANDARDS GNExCP7-I and STExCP8-I units with DIN Rail		CHECKED B.ISARD DATE 02-02-2024		MATERIAL		TITLE GNExCP7-I & STExCP8-I IS CALL POINT WIRING / CIRCUIT OPERATION DIAGRAM										SCALE NTS		SHEET 1 OF 1		DRAWING NUMBER D202-06-501	
APPROVED R.N.POTTS DATE 02-02-2024		ALTERNATIVE MATERIAL																			

1		2		3		4		5		6		7		8		9		10					
SINGLE MICROSWITCH DEVICES						SHEET 1						Module Device Codes		ISSUE		MOD No.		REASON - INITIAL - DATE					
PRODUCTS: GNExCP7, STExCP8		Diagram		Sheet		GNExCP7-BG[s][t][l][e][m][d][v][o][x][-][u][e][s]						LED Indicator [u]		Resistor		EOL		Series					
		LED Indicator Wiring Configurations		2,4		Switch Type [s] Terminals [t]						Product Version [v]		Diode		ED1		SD1					
		Parallel Dual Switch Wiring Configurations		3,4								Product Option [o]		Zener Diode		ExxxZ		SxxxZ					
												EOL Module [e]		LED		N/A		L or C					
SINGLE SWITCH		CONFIG. P1 -1		SINGLE SWITCH WITH SERIES DEVICE		CONFIG. P1-2		SINGLE SWITCH WITH EOL & SERIES DEVICES		CONFIG. P1-3		SINGLE SWITCH WITH EOL & ALT SERIES DEVICES		CONFIG. P1-4									
SWITCH TYPE [s] TERMINALS [t] PRODUCT OPTION [o] LED INDICATOR [u]		[S] [P] [R] [N]		Single PCB Version With EOL/Series NO LED		SWITCH TYPE [s] TERMINALS [t] PRODUCT OPTION [o] LED INDICATOR [u] EOL MODULE [e]		[S] [P] [R] [N] [Exxxx]		Single PCB Version With EOL/Series NO LED EOL Device		SWITCH TYPE [s] TERMINALS [t] PRODUCT OPTION [o] LED INDICATOR [u] MODULES [e][s]		[S] [P] [R] [N] [Exxxx][Sxxxx]		Single PCB Version With EOL/Series NO LED EOL + Series		SWITCH TYPE [s] TERMINALS [t] PRODUCT OPTION [o] LED INDICATOR [u] MODULE [e][s]		[S] [P] [W] [N] [Exxxx][Sxxxx]		Single PCB Version Alt. EOL Pos'n. NO LED EOL + Series	
Note :- Use when EOL and/or series devices are fitted during installation, or if no series devices are required.																							
Circuit as shown in Unoperated condition Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 open Terminals +(1) & (2) M/S 1 closed Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 open Terminals +(1) & -(3) M/S 1 closed		Circuit as shown in Unoperated condition Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 open Terminals +(1) & (2) M/S 1 closed Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 open Terminals +(1) & -(3) M/S 1 closed		Circuit as shown in Unoperated condition Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 open Terminals +(1) & (2) M/S 1 closed Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 open Terminals +(1) & -(3) M/S 1 closed		Circuit as shown in Unoperated condition Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 open Terminals +(1) & (2) M/S 1 closed Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 open Terminals +(1) & -(3) M/S 1 closed		Circuit as shown in Unoperated condition Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 open Terminals +(1) & (2) M/S 1 closed Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 open Terminals +(1) & -(3) M/S 1 closed		Circuit as shown in Unoperated condition Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 open Terminals +(1) & (2) M/S 1 closed Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 open Terminals +(1) & -(3) M/S 1 closed		Circuit as shown in Unoperated condition Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 open Terminals +(1) & (2) M/S 1 closed Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 open Terminals +(1) & -(3) M/S 1 closed		Circuit as shown in Unoperated condition Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 open Terminals +(1) & (2) M/S 1 closed Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 open Terminals +(1) & -(3) M/S 1 closed		Circuit as shown in Unoperated condition Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 open Terminals +(1) & (2) M/S 1 closed Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 open Terminals +(1) & -(3) M/S 1 closed		Circuit as shown in Unoperated condition Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 open Terminals +(1) & (2) M/S 1 closed Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 open Terminals +(1) & -(3) M/S 1 closed		Circuit as shown in Unoperated condition Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 open Terminals +(1) & (2) M/S 1 closed Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 open Terminals +(1) & -(3) M/S 1 closed			
DRAWING TO BS8888:2000 GEOMETRIC TOLERANCES TO ISO1101:1983 LINEAR DIMENSIONAL TOLS ANGULAR DIMENSIONAL TOLS		DRAWN R.N.POTTS 02-02-2024		DATE		SURFACE FINISH		WEIGHT (Kg)		THIS DRAWING AND ANY INFORMATION OR DESCRIPTIVE MATTER THEREIN IS COMMUNICATED IN CONFIDENCE AND IS THE COPYRIGHT PROPERTY OF EUROPEAN SAFETY SYSTEMS LTD. NEITHER THE WHOLE OR ANY EXTRACT MAY BE DISCLOSED, LOANED, COPIED OR USED FOR MANUFACTURING OR TENDERING PURPOSES WITHOUT THEIR WRITTEN CONSENT.		E2S warning signals		ALL DIMENSIONS IN MM IF IN DOUBT, ASK - DO NOT SCALE				A3					
STANDARDS GNExCP7-IR and STExCP8-IR units with PCB		CHECKED B.ISARD 02-02-2024		DATE		MATERIAL				EUROPEAN SAFETY SYSTEMS LTD. AS PER LATEST DATE OF ISSUE SHOWN ABOVE		EUROPEAN SAFETY SYSTEMS LTD IMPRESS HOUSE MANSELL ROAD ACTON LONDON W3 7QH WWW.E2S.COM		TITLE GNExCP7-IR & STExCP8-IR IS CALL POINT WIRING / CIRCUIT OPERATION DIAGRAM									
		APPROVED R.N.POTTS 02-02-2024		DATE		ALTERNATIVE MATERIAL								SCALE NTS		SHEET 1 OF 4		DRAWING NUMBER D202-06-502					

1		2		3		4		5		6		7		8		9		10											
SINGLE MICROSWITCH LED DEVICES						SHEET 2						Module Device Codes		ISSUE		MOD No.		REASON - INITIAL - DATE											
GNEXCP7-BG[s][t][l][e][m][d][v][o][x]-[u][e][s] Switch Type [s] Terminals [t] Product Version [v] LED Indicator [u] Series Module [s] EOL Module [e]						Resistor		EOL		Series		1		Introduction RNP 02-02-2024		2		ACN0178		LED C and L version clarified ; LED mounted in N/O position on switch RNP 04-04-2025									
						Diode		ED1		SD1																			
						Zener Diode		ExxxZ		SxxxZ																			
						LED		N/A		L or C																			
SINGLE SWITCH				CONFIG. P4 -1		SINGLE SWITCH WITH SERIES DEVICES				CONFIG. P4-2		SINGLE SWITCH WITH EOL & SERIES DEVICES				CONFIG. P4-3		SINGLE SWITCH WITH EOL & ALT SERIES DEVICES				CONFIG. P4-4							
SWITCH TYPE [s] TERMINALS [t] PRODUCT OPTION [o] LED INDICATOR [u]				[S] [P] [R] [L]		Single PCB Version With EOL/Series LED with RL1				[S] [P] [R] [L] [Exxxx]		Single PCB Version With EOL/Series LED with RL1 EOL Device				[S] [P] [R] [L] [Exxxx][Sxxxx]		Single PCB Version With EOL/Series LED with RL1 EOL + Series				[S] [P] [W] [L] [Exxxx][Sxxxx]				Single PCB Version Alt. EOL Pos'n. LED with RL1 EOL + Series			
Notes - For all LED Options: 1) The LED is configured as LED indicator option 'C' for this version the LED must be protected by a series resistor of a minimum value of 1.5K Ohm or by limiting the systems current to 20mA max 2) Units have the option to add the LED current-limiting resistor RL1 LED indicator option 'L' which is 1.5K Ohms. 3) Note that in both cases the total value of the series resistors and if fitted RL1 will impact the brightness of the LED.																													
Circuit as shown in Unoperated condition Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 open Terminals +(1) & (2) M/S 1 closed Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 open Terminals +(1) & -(3) M/S 1 closed						Circuit as shown in Unoperated condition Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 open Terminals +(1) & (2) M/S 1 closed Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 open Terminals +(1) & -(3) M/S 1 closed						Circuit as shown in Unoperated condition Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 open Terminals +(1) & (2) M/S 1 closed Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 open Terminals +(1) & -(3) M/S 1 closed						Circuit as shown in Unoperated condition Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 open Terminals +(1) & (2) M/S 1 closed Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 open Terminals +(1) & -(3) M/S 1 closed											
DRAWING TO BS8888:2000 GEOMETRIC TOLERANCES TO ISO1101:1983 LINEAR DIMENSIONAL TOLS ANGULAR DIMENSIONAL TOLS				DRAWN R.N.POTTS DATE 02-02-2024		SURFACE FINISH		WEIGHT (Kg)		THIS DRAWING AND ANY INFORMATION OR DESCRIPTIVE MATTER THEREIN IS COMMUNICATED IN CONFIDENCE AND IS THE COPYRIGHT PROPERTY OF EUROPEAN SAFETY SYSTEMS LTD. NEITHER THE WHOLE OR ANY EXTRACT MAY BE DISCLOSED, LOANED, COPIED OR USED FOR MANUFACTURING OR TENDERING PURPOSES WITHOUT THEIR WRITTEN CONSENT.				 warning signals EUROPEAN SAFETY SYSTEMS LTD IMPRESS HOUSE MANSELL ROAD ACTON LONDON W3 7QH WWW.E2S.COM		ALL DIMENSIONS IN MM IF IN DOUBT, ASK - DO NOT SCALE				A3									
STANDARDS GNEXCP7-IR and STEXCP8-IR units with PCB				CHECKED B.ISARD DATE 02-02-2024		MATERIAL		ALTERNATIVE MATERIAL		TITLE GNEXCP7-IR & STEXCP8-IR IS CALL POINT WIRING / CIRCUIT OPERATION DIAGRAM																			
				APPROVED R.N.POTTS DATE 02-02-2024																		SCALE NTS		SHEET 2 OF 4		DRAWING NUMBER D202-06-502			

1		2		3		4		5		6		7		8		9		10								
DUAL MICROSWITCH IN PARALLEL, & DEVICES						SHEET 3						Module Device Codes			ISSUE		MOD No.		REASON - INITIAL - DATE							
Notes: 1. Units have the option to remove the LED current-limiting resistor RL1 option 'L' using LED option 'C'. In all other cases shown RL1 is included.						GNEXCP7-BG[s][t][l][e][m][d][v][o][x][u][e][s]			LED Indicator [u]			EOL		Series		1		Introduction RNP 02-02-2024								
						Switch Type [s]			Product Version [v]			Resistor		EOL		Diode		ED1		2		ACN0178				
						Terminals [t]			Product Option [o]			Diode		ExxxZ		Zener Diode		ExxxZ		LED C and L version clarified ; LED mounted in N/O position on switch RNP 04-04-2025						
									Option [o]			LED		N/A		L or C										
DUAL SWITCH PARALLEL						CONFIG. P7-1			DUAL SWITCH, PARALLEL WITH EOL & SERIES DEVICES						CONFIG. P7-2			DUAL SWITCH, PARALLEL WITH EOL & ALT. SERIES DEVICES						CONFIG. P7-3		
SWITCH TYPE [s] TERMINALS [t] PRODUCT OPTION [o] LED INDICATOR [u]						Dual PCB Version With EOL/Series No LED			SWITCH TYPE [s] TERMINALS [t] PRODUCT OPTION [o] LED INDICATOR [u] MODULES [e][s]						Dual PCB Version Alt. EOL Pos'n. No LED EOL + Series			SWITCH TYPE [s] TERMINALS [t] PRODUCT OPTION [o] LED INDICATOR [u] MODULES [e][s]						Dual PCB Version Alt. EOL Pos'n. No LED EOL + Series		
Note :- Use when EOL and/or series devices are fitted during installation, or if no series devices are required.																										
Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 and M/S 2 open Terminals +(1) & (2) M/S 1 and M/S 2 closed						Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 and M/S 2 open Terminals +(1) & (2) M/S 1 and M/S 2 closed						Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 and M/S 2 open Terminals +(1) & (2) M/S 1 and M/S 2 closed						Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 and M/S 2 open Terminals +(1) & (2) M/S 1 and M/S 2 closed								
Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 and M/S 2 open Terminals +(1) & -(3) M/S 1 and M/S 2 closed						Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 and M/S 2 open Terminals +(1) & -(3) M/S 1 and M/S 2 closed						Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 and M/S 2 open Terminals +(1) & -(3) M/S 1 and M/S 2 closed						Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 and M/S 2 open Terminals +(1) & -(3) M/S 1 and M/S 2 closed								
DRAWING TO BS8888:2000 GEOMETRIC TOLERANCES TO ISO1101:1983 LINEAR DIMENSIONAL TOLS ANGULAR DIMENSIONAL TOLS						DRAWN R.N.POTTS 02-02-2024						CHECKED B.ISARD 02-02-2024						APPROVED R.N.POTTS 02-02-2024								
STANDARDS GNExCP7-IR and STEXCP8-IR units with PCB						SURFACE FINISH						MATERIAL						ALTERNATIVE MATERIAL								

1		2		3		4		5		6		7		8		9		10									
DUAL MICROSWITCH IN PARALLEL, LED & DEVICES				SHEET 4								Module Device Codes				ISSUE		MOD No.		REASON - INITIAL - DATE							
				GNEXCP7-BG[s][t][l][e][m][d][v][o][x]-[u][e][s]				LED Indicator [u]				Resistor				1				Introduction RNP 02-02-2024							
				Switch Type [s] Terminals [t]				Product Version [v]				Product Option [o]				Diode				2		ACN0178		LED C and L version clarified ; LED mounted in N/O position on switch RNP 04-04-2025			
												Series Module [s] EOL Module [e]				Zener Diode											
												LED				N/A				L or C							
DUAL SWITCH PARALLEL WITH LED				CONFIG. P8-1				DUAL SWITCH PARALLEL WITH LED, EOL & SERIES DEVICES				CONFIG. P8-2				DUAL SWITCH PARALLEL WITH LED, EOL & ALT. SERIES DEVICES				CONFIG. P8-3							
SWITCH TYPE [s] [D] TERMINALS [t] [P] PRODUCT OPTION [o] [R] LED INDICATOR [u] [L]				Dual PCB Version With EOL/Series LED with RL1				SWITCH TYPE [s] [D] TERMINALS [t] [P] PRODUCT OPTION [o] [R] LED INDICATOR [u] [L] MODULES [e][s]				Dual PCB Version With EOL/Series LED with RL1 EOL + Series				SWITCH TYPE [s] [D] TERMINALS [t] [P] PRODUCT OPTION [o] [W] LED INDICATOR [u] [L] MODULES [e][s]				Dual PCB Version Alt. EOL Pos'n. LED with RL1 EOL + Series							
Notes - For all LED Options:																											
1) The LED is configured as LED indicator option 'C' for this version the LED must be protected by a series resistor of a minimum value of 1.5K Ohm or by limiting the systems current to 20mA max																											
2) Units have the option to add the LED current-limiting resistor RL1 LED indicator option 'L' which is 1.5K Ohms.																											
3) Note that in both cases the total value of the series resistors and if fitted RL1 will impact the brightness of the LED.																											
Circuit as shown in Unoperated condition				Circuit as shown in Unoperated condition				Circuit as shown in Unoperated condition				Circuit as shown in Unoperated condition				Circuit as shown in Unoperated condition											
Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 and M/S 2 open Terminals +(1) & (2) M/S 1 and M/S 2 closed				Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 and M/S 2 open Terminals +(1) & (2) M/S 1 and M/S 2 closed				Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 and M/S 2 open Terminals +(1) & (2) M/S 1 and M/S 2 closed				Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 and M/S 2 open Terminals +(1) & (2) M/S 1 and M/S 2 closed				Unoperated Condition (Glass Intact / Standby Condition) Terminals +(1) & -(3) M/S 1 and M/S 2 open Terminals +(1) & (2) M/S 1 and M/S 2 closed											
Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 and M/S 2 open Terminals +(1) & -(3) M/S 1 and M/S 2 closed				Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 and M/S 2 open Terminals +(1) & -(3) M/S 1 and M/S 2 closed				Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 and M/S 2 open Terminals +(1) & -(3) M/S 1 and M/S 2 closed				Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 and M/S 2 open Terminals +(1) & -(3) M/S 1 and M/S 2 closed				Operated Condition (Glass Broken / Button pushes in) Terminals +(1) & (2) M/S 1 and M/S 2 open Terminals +(1) & -(3) M/S 1 and M/S 2 closed											
DRAWING TO BS8888:2000 GEOMETRIC TOLERANCES TO ISO1101:1983 LINEAR DIMENSIONAL TOLS ANGULAR DIMENSIONAL TOLS				DRAWN R.N.POTTS DATE 02-02-2024				SURFACE FINISH				WEIGHT (Kg)				THIS DRAWING AND ANY INFORMATION OR DESCRIPTIVE MATTER THEREIN IS COMMUNICATED IN CONFIDENCE AND IS THE COPYRIGHT PROPERTY OF EUROPEAN SAFETY SYSTEMS LTD. NEITHER THE WHOLE OR ANY EXTRACT MAY BE DISCLOSED, LOANED, COPIED OR USED FOR MANUFACTURING OR TENDERING PURPOSES WITHOUT THEIR WRITTEN CONSENT.				ALL DIMENSIONS IN MM IF IN DOUBT, ASK - DO NOT SCALE				A3			
STANDARDS GNExCP7-IR and STExCP8-IR units with PCB				CHECKED B.ISARD DATE 02-02-2024				MATERIAL								EUROPEAN SAFETY SYSTEMS LTD. IMPRESS HOUSE MANSELL ROAD ACTON LONDON W3 7QH WWW.E2S.COM				TITLE GNExCP7-IR & STExCP8-IR IS CALL POINT WIRING / CIRCUIT OPERATION DIAGRAM							
				APPROVED R.N.POTTS DATE 02-02-2024				ALTERNATIVE MATERIAL								SCALE NTS				SHEET 4 OF 4				DRAWING NUMBER D202-06-502			

EU Declaration of Conformity



Manufacturer: European Safety Systems Ltd.
Impress House, Mansell Road, Acton
London, W3 7QH
United Kingdom

Authorised Representative: E2S Warnsignaltechnik UG
Charlottenstrasse 45-51
72764 Reutlingen
Germany

Equipment Type: GNExCP7-BG-I, GNExCP7-IR
GNExCP7-PB-I, GNExCP7-PM-I, GNExCP7-PT-I
GNExCP7-PB-IR, GNExCP7-PM-IR, GNExCP7-PT-IR

Directive 2014/34/EU: Equipment and Protective Systems for use in Potentially Explosive Atmospheres (ATEX)

Notified Body for EU type Examination (Module B):	UL International Demko A/S Notified Body No.: 0539 Borupvang 5A, 2750 Ballerup, Denmark
EU-type Examination Certificate (Module B):	DEMKO 19 ATEX 2101X
Notified Body for Quality Assurance Notification / Conformity to EU-type based on quality assurance of the production process (Module D):	Sira Certification Service Notified Body No.: 2813 CSA Group Netherlands B.V, Utrechtseweg 310, 6812 AR, Arnhem, Netherlands
Quality Assurance Notification (Module D):	SIRA 05 ATEX M342
Provisions fulfilled by the equipment:	II 1G Ex ia IIC T6...T4 Ga
Standards applied:	EN 60079-0:2018 EN 60079-11:2012

Directive 2014/30/EU: Electromagnetic Compatibility Directive (EMC)

Standards applied:	EN 61000-6-1:2007 EN 61000-6-2:2005 EN 61000-6-3:2007 / A1:2011 / AC: 2012 EN 61000-6-4:2007 / A1: 2011
--------------------	--

Directive 2011/65/EU: Restriction of the use of certain hazardous substances in electrical and electronic equipment (RoHS)

The product and all the components contained within it are in accordance with the restriction of the use of hazardous substances in electrical and electronic equipment, including amendment by Directive 2015/863/EU.

Regulation (EC) 1907/2006: Registration, Evaluation, Authorisation and Restriction of Chemicals (REACH)

The product and all the components contained within it are free from substances of very high concern.

Other Standards and Regulations

EN 60529:1991 + A1:2000 + A2:2013. - Degrees of protection provided by enclosures (IP code) – enclosure rated IP66/67

On behalf of European Safety Systems Ltd., I declare that, on the date the equipment accompanied by this declaration is placed on the market, the equipment conforms with all technical and regulatory requirements of the above listed directives, regulations and standards.

This Declaration is issued under the sole responsibility of the manufacturer.


Martin Streetz
Quality Assurance Manager

Document No.: DC-115_Issue_A
Date and Place of Issue: London, 29/02/2024



UKCA Declaration of Conformity



Manufacturer: European Safety Systems Ltd.
Impress House, Mansell Road, Acton
London, W3 7QH
United Kingdom

Equipment Type: GNExCP7-BG-I, GNExCP7-BG-IR
GNExCP7-PB-I, GNExCP7-PM-I, GNExCP7-PT-I,
GNExCP7-PB-IR, GNExCP7-PM-IT, GNExCP7-PT-IR,

Directive UKSI 2016:1107 (as amended by UKSI 2019:696) – Schedule 3A, Part 1: Product or Protective System Intended for use in Potentially Explosive Atmospheres (UKCA)

Notified Body for UK type Examination (Module B):	UL International (UK) Ltd Notified Body No.: 0843 Unit 1-3 Horizon Kingsland Business Park, Wade Road, Basingstoke, Hampshire RG24 8AH UK
UK-type Examination Certificate (Module B):	UL21UKEX2134X
Notified Body for Quality Assurance Notification / Conformity to EU-type based on quality assurance of the production process (Module D):	Sira Certification Service Notified Body No.: 0518 Rake Lane, Eccleston, Chester CH4 9JN, UK
Quality Assurance Notification (Module D):	CSAE 22UKQAN0046
Provisions fulfilled by the equipment:	II 1G Ex ia IIC T6...T4 Ga
Standards applied:	EN 60079-0:2018 EN 60079-11:2012

Directive 2014/30/EU: Electromagnetic Compatibility Directive (EMC)

Standards applied:	EN 61000-6-1:2007 EN 61000-6-2:2005 EN 61000-6-3:2007 / A1:2011 / AC: 2012 EN 61000-6-4:2007 / A1: 2011
--------------------	--

Directive 2011/65/EU: Restriction of the use of certain hazardous substances in electrical and electronic equipment (RoHS)

The product and all the components contained within it are in accordance with the restriction of the use of hazardous substances in electrical and electronic equipment, including amendment by Directive 2015/863/EU.

Regulation (EC) 1907/2006: Registration, Evaluation, Authorisation and Restriction of Chemicals (REACH)

The product and all the components contained within it are free from substances of very high concern.

Other Standards and Regulations

EN 60529:1991 + A1:2000 + A2:2013. - Degrees of protection provided by enclosures (IP code) – enclosure rated IP66/67/68

On behalf of European Safety Systems Ltd., I declare that, on the date the equipment accompanied by this declaration is placed on the market, the equipment conforms with all technical and regulatory requirements of the above listed directives, regulations and standards.

This Declaration is issued under the sole responsibility of the manufacturer.

Martin Streetz
Quality Assurance Manager

Document No.:
Date and Place of Issue:

DC-117_Issue_A
London, 29/02/2024