ISSUE	MOD No.	REASON - INITIAL - DATE
1		Introduction. MA - 08/04/2025

E2S PART NO
D1xCF[XX][SXX]


DESCRIPTION
D1xCF COMBINED HORN STROBE FOR FIRE ALARM IN EXPLOSIONPROOF AREAS

Note: Alternative wiring configurations may be available on request - contact E2S sales

CONFIG. 1

24 VDC VOLTAGE SUPPLY

STROBE AND ALARM HORN STAGE 1 LINKED

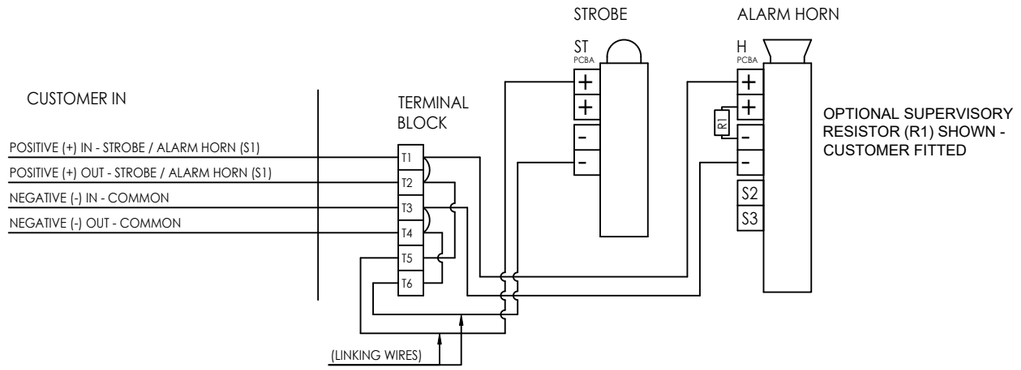


NOTES:

When power is applied across terminals T1/T2 and T3/T4, the Strobe is triggered simultaneously with the Alarm Horn S1.

Optional independent connections to the Strobe and the Alarm Horn is available by removing the linking wire in the Strobe enclosure.
Refer to D226-00-325-IS for the procedure to convert to independent wiring.

To open the Strobe, refer to the selected unit's Instruction Manual for guidelines for access to enclosure.
To open the Alarm Horn, refer to D190-00-001-IS for guidelines for access to enclosure.

ENTRY TERMINALS

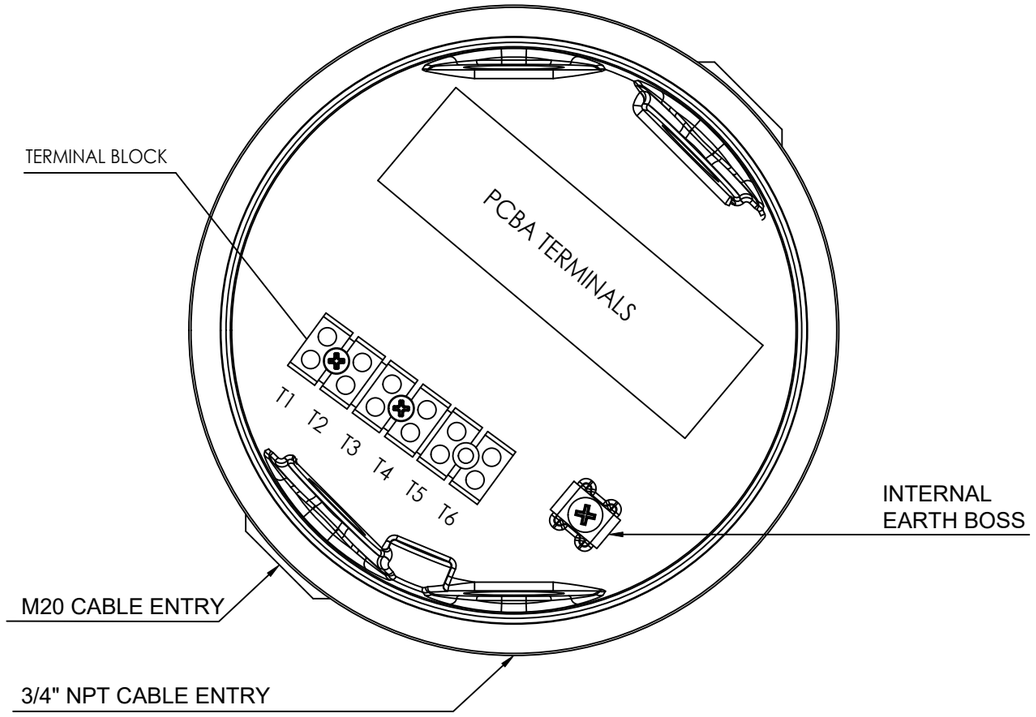

DRAWING TO BS8888:2000 GEOMETRIC TOLERANCES TO ISO1101:1983 LINEAR DIMENSIONAL TOLS ANGULAR DIMENSIONAL TOLS	DRAWN M.ABALOS DATE 08/04/2025	SURFACE FINISH	WEIGHT (Kg)
STANDARDS D1xCF	CHECKED R.N.POTTS DATE 08/04/2025	MATERIAL	
	APPROVED R.N.POTTS DATE 08/04/2025	ALTERNATIVE MATERIAL	

THIS DRAWING AND ANY INFORMATION OR DESCRIPTIVE MATTER THEREIN IS COMMUNICATED IN CONFIDENCE AND IS THE COPYRIGHT PROPERTY OF EUROPEAN SAFETY SYSTEMS LTD. NEITHER THE WHOLE OR ANY EXTRACT MAY BE DISCLOSED, LOANED, COPIED OR USED FOR MANUFACTURING OR TENDERING PURPOSES WITHOUT THEIR WRITTEN CONSENT.
© EUROPEAN SAFETY SYSTEMS LTD.
AS PER LATEST DATE OF ISSUE SHOWN ABOVE

EUROPEAN SAFETY SYSTEMS LTD
IMPRESS HOUSE
MANSELL ROAD
ACTON
LONDON W3 7QH
WWW.E2S.COM

ALL DIMENSIONS IN MM
IF IN DOUBT, ASK -
DO NOT SCALE

A2

TITLE D1xCF 24 VDC COMBINED HORN STROBE - WIRING SCHEMATIC

SCALE | SHEET | DRAWING NUMBER D226-06-325